NOTES:

1– This is a concept drawing. Designers must determine if this system is appropriate for a specific application. Installation must comply with local code requirements, and if necessary, auxiliary equipment and saftey devices must be added. For additional information, see Jaguar Caravan Multiple & Cascading Boiler Application Guide CJ–10–HWG.

2– Check local codes for required spacing between boilers.

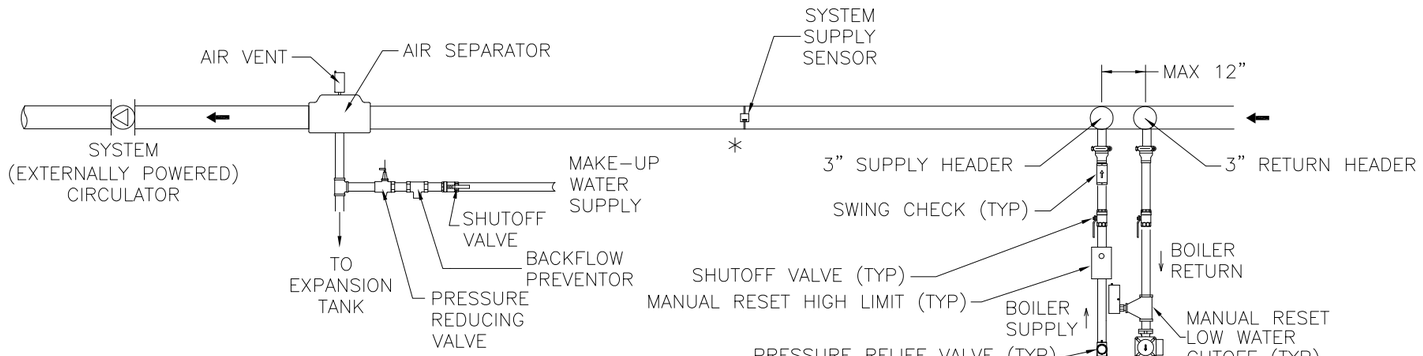

RIGHT SIDE VIEW

*NOTE: S/F HEADERS AND BUILDING PIPING MUST BE RIGIDLY SECURED TO SUPPORT THE WEIGHT OF THE PIPES AND PREVENT MOVEMENT.

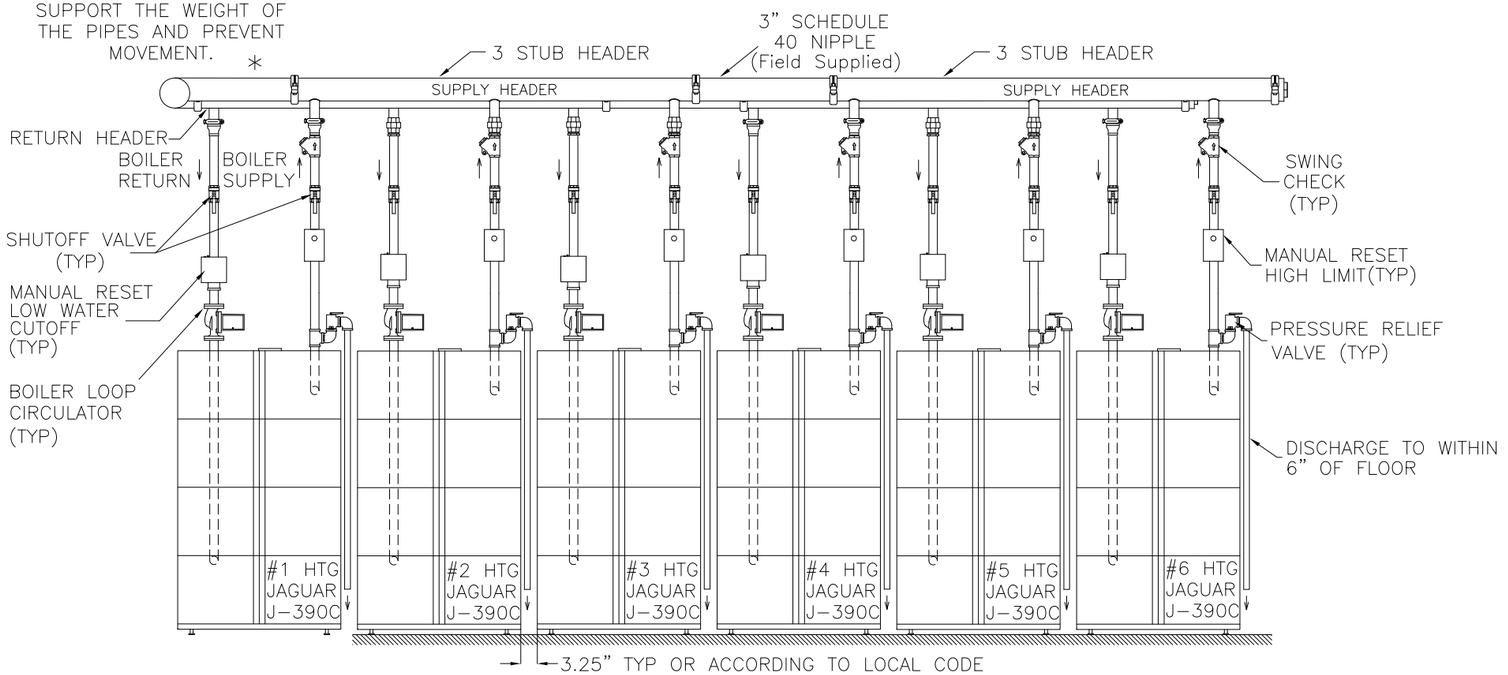

ELEVATION VIEW

DWG FILE – J–390C 6B

SLANT/FIN CORPORATION
100 FOREST DRIVE, GREENVALE, NEW YORK 11548 / 516–484–2600

TITLE		
J–390C 6B JAGUAR, HOT WATER MULTIPLE SYSTEM		
DATE	DRAWN BY	DRAWING NUMBER
4–12–12	REG	J–390C 6B
DATE	APPROVED	